
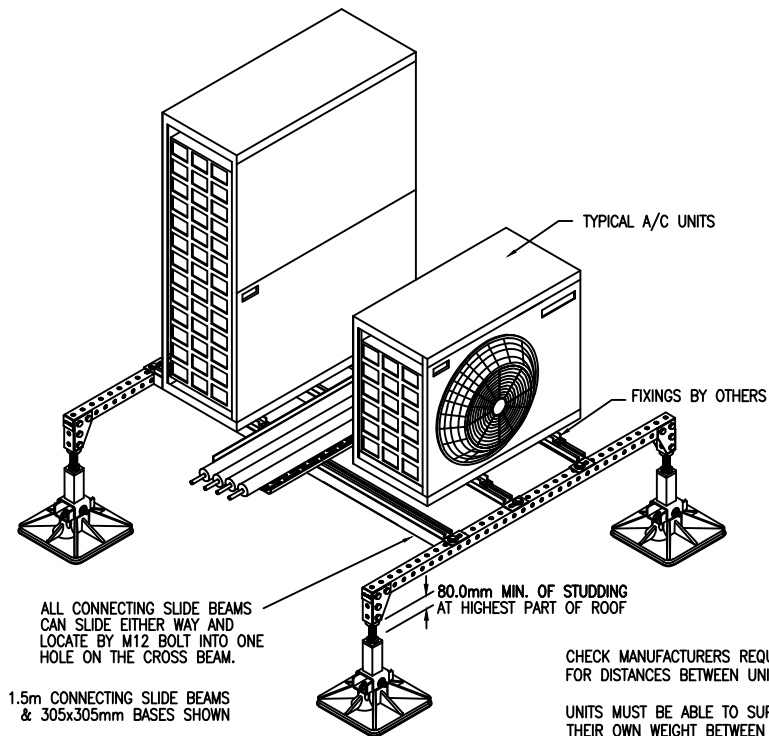


CHECK MANUFACTURERS REQUIREMENTS FOR DISTANCES BETWEEN UNITS.

UNITS MUST BE ABLE TO SUPPORT THEIR OWN WEIGHT BETWEEN SPANS.

ALL REFRIGERANT PIPE WORK IS TO BE SUPPORTED AT CONDENSOR HEIGHT SEE TAB-C CABLE TRAY & SMALL PIPE SUPPORTS (DRG. No. FT-004).

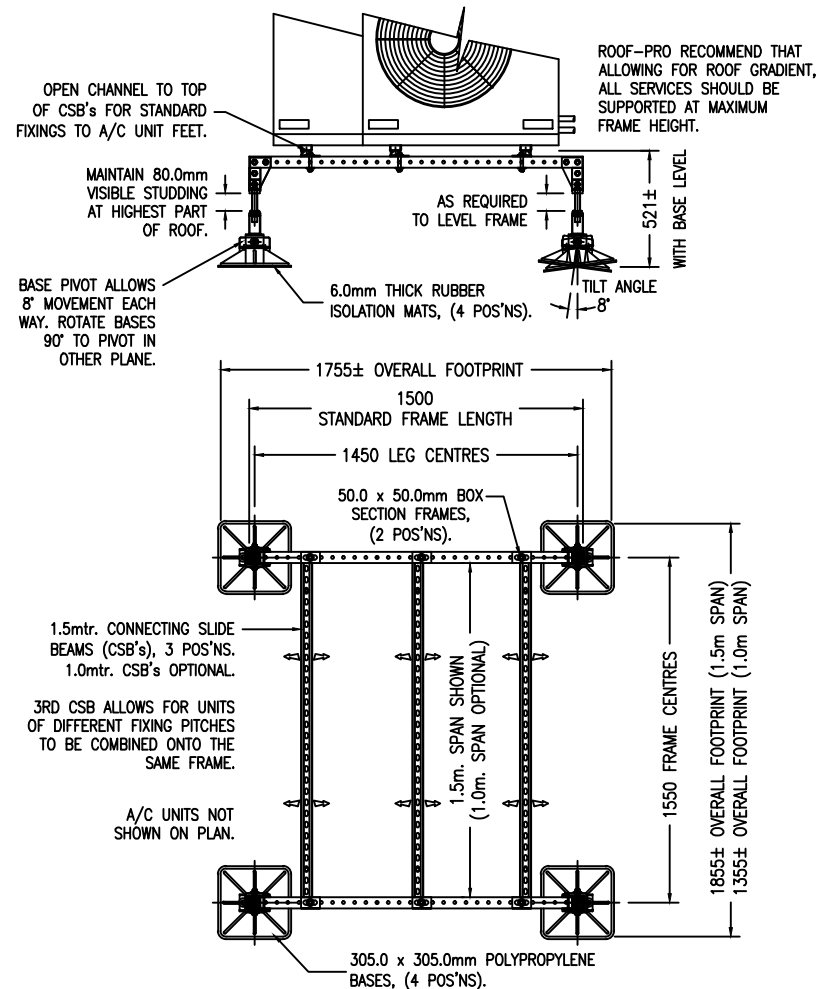

CHECK MANUFACTURERS REQUIREMENTS FOR DISTANCES BETWEEN UNITS.

UNITS MUST BE ABLE TO SUPPORT THEIR OWN WEIGHT BETWEEN SPANS.

ALL REFRIGERANT PIPE WORK IS TO BE SUPPORTED AT CONDENSOR HEIGHT SEE TAB-C CABLE TRAY & SMALL PIPE SUPPORTS (DRG. No. FT-004).

© COPYRIGHT ROOF-PRO

ISSUE 10	
ISSUE 9	
ISSUE 8	
ISSUE 7	
ISSUE 6	
ISSUE 5	
ISSUE 4	
ISSUE 3	
ISSUE 2	02.03.16
ISSUE 1	11.05.12



Polwell Lane, off Station Road  
Burton Latimer NN15 5PS, UK  
Tel: +44 (0)1744 648 400  
Email: cad@roof-pro.co.uk  
Website: www.roof-pro.co.uk

PRODUCT:  
PF1 12x4TP 1.5m CSB's  
PF1.5 12x4TP 1.5m CSB's  
TYPICAL PRODUCT RANGE

MATERIAL/FINISH:  
  
MILD STEEL  
HOT DIP GALVANISED

SCALE © A3:	N.T.S.
DRAWN BY:	CAD
DATE:	11/05/12
CHECKED BY:	CAD
DATE:	11/05/12
DRAWING No:	FT-012